## Precedent Packaged Rooftop

### 

| Application              | Unit Size | Supply Fan |                          | External Dimensions (in.) |         |         | Operating Weight | Elevation |
|--------------------------|-----------|------------|--------------------------|---------------------------|---------|---------|------------------|-----------|
| DX Cooling /<br>Gas Heat | 8.5 Ton   | Airflow    | Total Static<br>Pressure | Height                    | Width   | Length  | 1095.0 lb        | 0.00 ft   |
|                          |           | 3400 cfm   | 0.500 in H2O             | 4.24 ft                   | 4.44 ft | 7.34 ft |                  |           |

| Unit Features   |                     |  |  |  |  |
|-----------------|---------------------|--|--|--|--|
| Unit Efficiency | Standard Efficiency |  |  |  |  |
| Refrigerant     | R-454B Refrigerant  |  |  |  |  |
| EER @ AHRI      | 11.00 Number        |  |  |  |  |
| IEER @ AHRI     | 14.60 Number        |  |  |  |  |

| Unit Electrical     |              |  |  |  |  |
|---------------------|--------------|--|--|--|--|
| Voltage/phase/hertz | 208-230/60/3 |  |  |  |  |
| MCA                 | 53.00 A      |  |  |  |  |
| MOP                 | 70.00 A      |  |  |  |  |
| Condenser Fan FLA   | 1.50 A       |  |  |  |  |
| Evaporator Fan FLA  | 8.80 A       |  |  |  |  |
| Compressor 1 RLA    | 21.80 A      |  |  |  |  |
| Compressor 2 RLA    | 13.20 A      |  |  |  |  |
| Compressor Power    | 7.41 kW      |  |  |  |  |
| System Power        | 10.21 kW     |  |  |  |  |



#### **Controls**

#### Unit Controls Symbio 700

| Cooling Section                 |          |                         |            |  |
|---------------------------------|----------|-------------------------|------------|--|
| Entering Dry Bulb               | 80.00 F  | Capacity                |            |  |
| Entering Wet Bulb               | 67.00 F  | Gross Total             | 113.12 MBh |  |
| Ambient Temp                    | 95.00 F  | Gross Latent            | 27.55 MBh  |  |
| Leaving Coil Dry Bulb           | 56.69 F  | Gross Sensible          | 85.57 MBh  |  |
| Leaving Coil Wet Bulb           | 56.14 F  | Net Total               | 109.76 MBh |  |
| Leaving Unit Dry Bulb           | 58.16 F  | Net Sensible            | 82.21 MBh  |  |
| Leaving Unit Wet Bulb           |          | Net Sensible Heat Ratio | 74.90 %    |  |
| Saturated Discharge Temperature | 121.66 F | Fan Motor Heat          | 1.84 MBh   |  |
| Saturated Suction Temperature   | 53.62 F  | Refrig Charge-Circuit 1 | 8.3 lb     |  |

| Heating Section         |               |
|-------------------------|---------------|
| Heating                 | High Gas Heat |
| Input Heating Capacity  | 200.00 MBh    |
| Output Heating Capacity | 162.00 MBh    |
| Heating EAT             | 65.00 F       |
| Heating LAT             | 108.60 F      |
| Heating Temp Rise       | 43.60 F       |
| Heating Stages          | 2             |

| Fan Section                  |                              |   |                 |  |  |
|------------------------------|------------------------------|---|-----------------|--|--|
| Indoor Fa                    | an Data                      | Indoor Fan Performance                  |                 |  |  |
| Airflow Application Downflow |                              | Airflow                                 | 3400 cfm        |  |  |
| Design ESP 0                 | 0.500 in H2O                 | Supply Motor Horsepower                 | 3.000 hp        |  |  |
| Component SP (               | 0.000 in H2O<br>0.000 in H2O | Total Supply Motor Operating<br>Power   | 0.917 hp        |  |  |
|                              | 0.500 in H2O                 | Indoor RPM                              | 1117 rpm        |  |  |
| Indoor Fan Drive Type \      | /ariable Direct              | Outdoor                                 |                 |  |  |
| Indoor Fan Quantity 1        | 1.00 Number                  | Outdoor Fan Drive Type                  |                 |  |  |
| Indoor Fan Type E            | BC Plenum                    | Outdoor Fan Quantity                    | 1               |  |  |
|                              |                              | Outdoor Fan Type                        | Propeller       |  |  |
|                              |                              | Filters                                 |                 |  |  |
|                              |                              | 1st Filter Size and Qty 2 - 18 x 24 x 2 |                 |  |  |
|                              |                              | 2nd Filter Size and Qty                 | 3 - 24 x 16 x 2 |  |  |


2025/04/23 12:12:47


| Acoustics        |       |        |        |        |       |       |       |       |
|------------------|-------|--------|--------|--------|-------|-------|-------|-------|
| Sound Path       | 63 Hz | 125 Hz | 250 Hz | 500 Hz | 1 kHz | 2 kHz | 4 kHz | 8 kHz |
| Ducted Discharge | 83 dB | 81 dB  | 73 dB  | 69 dB  | 63 dB | 61 dB | 61 dB | 61 dB |
| Ducted Inlet     | 76 dB | 74 dB  | 68 dB  | 56 dB  | 53 dB | 51 dB | 51 dB | 51 dB |
| Outdoor Noise    | 87 dB | 87 dB  | 86 dB  | 83 dB  | 81 dB | 77 dB | 73 dB | 67 dB |

Note: Ducted Discharge/Ducted Inlet prediction data conform to AHRI 260

2025/04/23 13:12:47 Page 2 of 8

NOTES: 1. VERIFY WEIGHTS, CONNECTIONS, AND ALL DIMENSIONS WITH INSTALLER DOCUMENTS BEFORE INSTALLATION

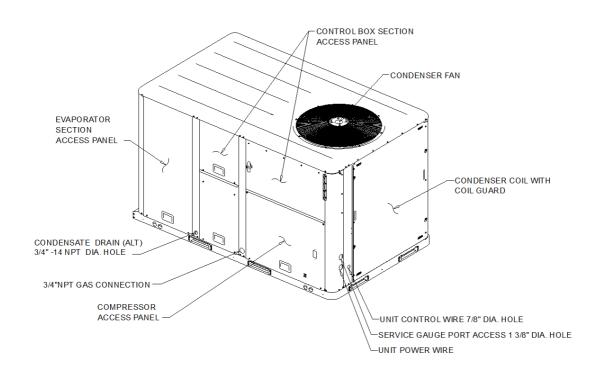


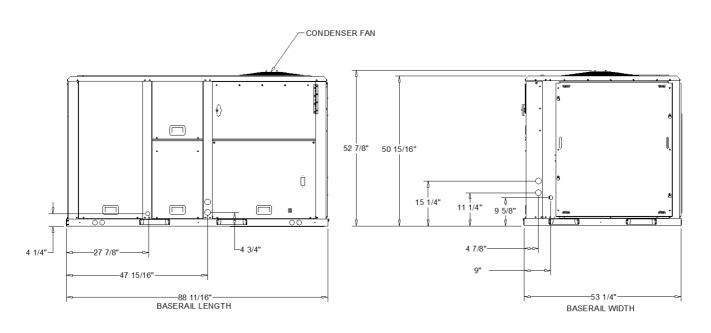


#### DX COOLING / GAS HEAT STANDARD EFFICIENCY

DIMENSION DRAWING

2025/04/23 13:12:47 Page 3 of 8

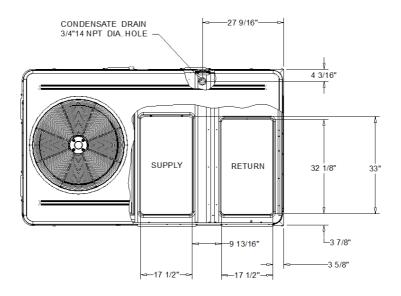

PLAN VIEW OF DOWNFLOW OPENINGS

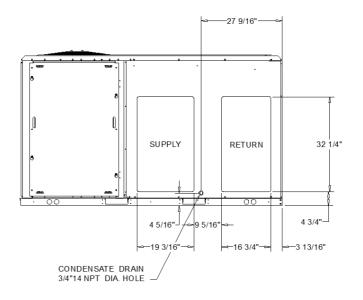

#### HORIZONTAL AIR FLOW OPENING

#### DX COOLING / GAS HEAT STANDARD EFFICIENCY

DIMENSION DRAWING

2025/04/23 13:12:47 Page 4 of 8

# NOT INCLUDE OPTIONS OR ACCESSORIES. 3. WEIGHT INCLUDES BOTH FACTORY AND FIELD INSTALLED ACCESSORY. Approximate Installed Weight: 1,095.0 lb HORIZONTAL FLOW CLEARANCE (18") DOWNFLOW FLOW CLEARANCE (36") (B) Corner Weight: 295.0 lb (A) Corner Weight: 345.0 lb (c) (D)CLEARANCE 36" CLEARANCE 36" 1.58 ft A $\bigcirc$ 3.42 ft -CLEARANCE 48" CLEARANCE 72" Ð CLEARANCE 36" CLEARANCE 36"

NOTES: 1. APPROX. INSTALLED WEIGHT INCLUDES ALL SELECTED OPTIONS AND ACCESSORIES. 2. CORNER WEIGHTS ARE FOR BASE UNIT ONLY AND DO

(C) Corner Weight: 165.0 lb

(D) Corner Weight: 193.0 lb

#### DX COOLING / GAS HEAT STANDARD EFFICIENCY


Ò

WEIGHTS AND CLEARANCES

2025/04/23 13:12:47 Page 5 of 8

#### NOTES:

INSTALLED DOCUMENTS REFORE INSTALLATION

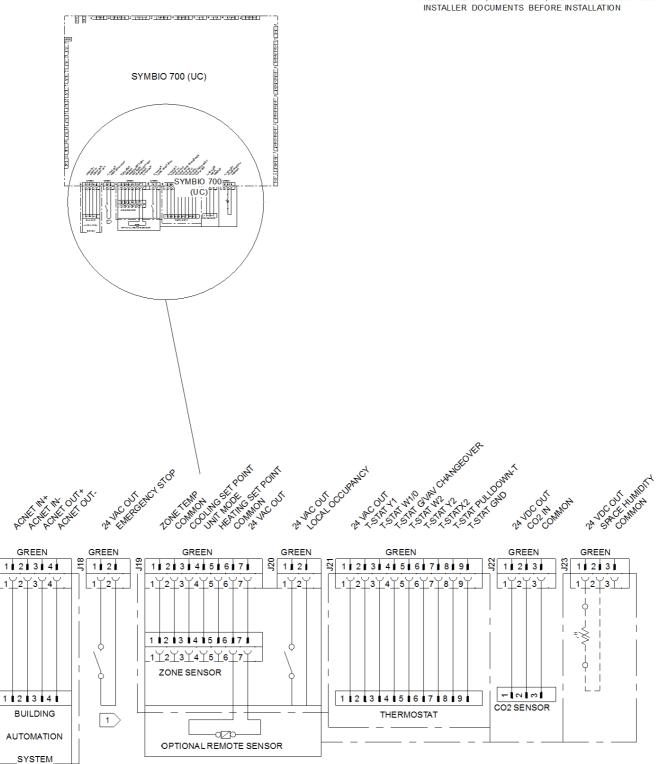

SYMBIO 700 (J17, j18, J19, J20, J21, J22, AND J23)

FIELD WIRING DRAWING

2025/04/23 13:12:47 Page 6 of 8

#### General

Packaged rooftop unit cooling capacities, heating capacities, and efficiencies are certified to the following standards:

- 3 to 5 ton units: AHRI Standard 210/240.
- 6 to 25 ton units: AHRI Standard 340/360.
- Gas Heating Units: ANSI Z21.47 and 10 CFR Part 431 for Commercial Warm Air.
- Convertible airflow.
- Symbio? controls operating range between 40°F and 125°F in cooling mode standard from the factory. Field-installed low ambient kit extends operating range down to 0°F.
- Factory assembled, internally wired, fully charged, and 100 percent run tested to verify cooling operation, fan and blower rotation, and control sequence.
- Colored and numbered wiring internal to the unit for simplified identification.
- cULus listed and classified in accordance for Central Cooling Air Conditioners.
- Unit shall be furnished with a leak detection system from the fact

#### Casing

- Zinc coated, heavy gauge, galvanized steel.
- Weather resistant pre-painted metal with galvanized substrate.
- Meets ASTM B117, 672 hour salt spray test.
- Removable single side maintenance access panels.
- Lifting handles in maintenance access panels (can be removed and reinstalled by removing fasteners while providing a water and air tight seal).
- Exposed vertical panels and top covers in the indoor air section insulated with a cleanable foil-faced, fire-retardant permanent, odorless glass fiber material.
- Base pan shall have no penetrations within the perimeter of the curb other than the raised 1 inch high downflow supply/return openings to provide an added water integrity precaution, if the condensate drain backs up.
- Base of the unit insulated with 1/8 inch, foil-faced, closed-cell insulation.
- Unit base provisions for forklift and/or crane lifting on three sides of unit.

#### **Hail Guards**

- Provides condenser coil protection.

#### Microchannel Coils

- Optimal heat transfer performance due to flat, streamlined tubes with small ports, and metallurgical tube-to-fin bond.
- Reduce system refrigerant charge by up to 50% leading to better compressor reliability.
- Compact all-aluminum microchannel coils reduce the unit weight.
- Recyclable all aluminum coils All aluminium construction minimizes galvanic corrosion.
- Strong aluminum brazed structure provides better fin protection.
- Flat streamlined tubes more dust resistant and easy to clean.
- Coils leak tested at the factory to ensure the pressure integrity.

#### Compressors

- All units have direct-drive, hermetic, scroll type compressors with centrifugal type oil pumps.
- Suction gas-cooled motor with voltage utilization range of plus or minus 10 percent of unit nameplate voltage.
- Internal overloads standard with scroll compressors.
- All units have dual compressors.
- -Three stages of cooling available on 6 to 17.5 tons units and four stages of cooling available on 20 and 25 tons units.

#### **Filters**

-Two inch standard filters shall be factory supplied on all units.

#### **Frostat**

- Utilized as a safety device.
- Opens to prevent freezing temperatures on evaporator coil.
- Temperature will need to rise to 50°F before closing.
- Utilized in low airflow or high outside air applications (cooling only).

#### **Gas Heating Section**

2025/04/23 13:12:47 Page 7 of 8

- -The heating section shall have a progressive tubular heat exchanger with corrosion-resistant aluminized steel tubes and burners as standard on all models.
- -Stainless steel heat exchanger with 409 stainless steel tubes and 439 stainless steel burners shall be optional.
- Induced draft combustion blower shall be used to pull the combustion products through the firing tubes.
- Heater shall use a direct spark ignition (DSI) system.
- On initial call for heat, the combustion blower shall purge the heat exchanger for 20 seconds before ignition.
- After three unsuccessful ignition attempts, entire heating system shall be locked out until manually reset at the thermostat/zone sensor.
- Units shall be suitable for use with natural gas or propane (field-installed kit).

#### Indoor Fan

- Direct drive plenum fan design 6 to 25 tons units.
- Plenum fan design backward-curved fan wheel along with an external rotor direct drive variable speed indoor motor.
- Supply fan speed adjustments can be made using the Symbio 700 or Mobile App.
- Motors are thermally protected.
- Variable speed direct drive motors are high efficiency 6 to 25 tons.

### **Heat Exchanger**

- Compact cabinet features a tubular heat exchanger in low, medium and high heat capacities.
- Corrosion-resistant aluminized steel tubes and burners are standard on all models.
- Induced draft blower to pull the gas mixture through the burner tubes.
- Direct spark ignition and a flame sensor as a safety device to validate the flame.

2025/04/23 13:12:47 Page 8 of 8