


MULTIPLES OF TRIP CURRENT RATING

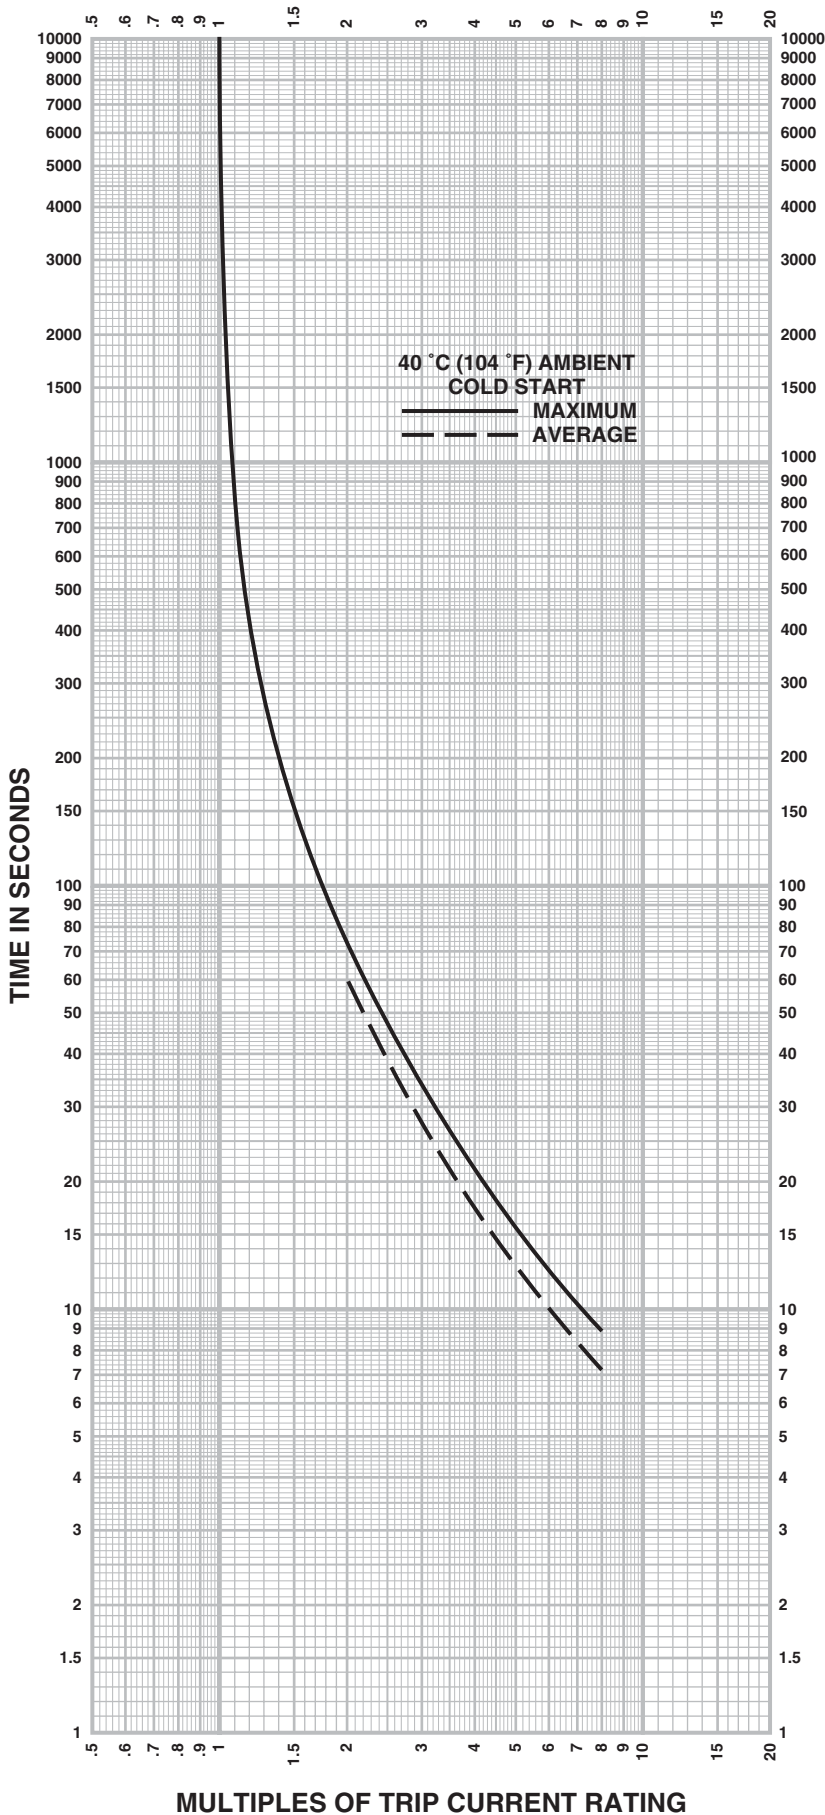

OVERLOAD RELAY
TIME-CURRENT CHARACTERISTICS
REFERENCE DRAWING NO. 30068-447

Relay Design	Melting Alloy
Thermal Unit Types	A.49-A25.2

40 °C ambient cold start trip time characteristics of:

Equipment	AC Manual Starter
Size	FHP
Type	F
Qty. of Thermal Units	1

When installed in:

- Small enclosure (Class 2510 only)
- Hinged door and all other (larger) enclosures

The trip current rating can be determined from the instructions given with the appropriate thermal unit selection table. The characteristics shown do not necessarily apply to equipment manufactured before the date of the referenced drawing.

TIME IN SECONDS

TIME IN SECONDS

MULTIPLES OF TRIP CURRENT RATING