Job Name/Location:			Tag #:
Date:	For: File	Resubmit	
PO No.:	Approval	Other	€ G
Architect: GC:			⊕ LG
Engr: Me	ch:		
Rep:	* Managarah		
(Company) (Project	t Manager)		
LV420HHV			
Single Zone LGRED° Vertical Air Handler L	Jnit		
Outdoor Unit (ODU) - LUU420HHV Indoor Unit (IDU) - L		Life's Good	
Performance:			
Cooling:		Operating Range	::
	42,000 ~ 50,000	Outdoor Unit: Cooling (°F DB)	5 to 118
SEER / EER	19.6 / 12.5	Heating (°F WB)	-13 to 64
SEER - Seasonal Energy Efficiency Ratio EER - Energy Efficiency Ratio		Indoor Unit:	
Heating: Heating Capacity (Min~Rated~Max, Btu/h) 18,000 ~	40,000 40,000	Cooling (°F WB)	57 to 77
HSPF	48,000 ~ 60,000 11.0	Heating (°F DB)	59 to 81
Max heating @ Indoor 70° DB (Btu/h)		System Data:	
Outdoor 17°F WB	52,200	Refrigerant Type/0	Control R410A / EEV
Outdoor 5°F WB	48,000	Refrigerant Charge	
Outdoor -4°F WB Outdoor -13°F WB	38,200	ODU Sound Pressi	ure Max (Cool / Heat) ±1 dB(A) ³ 54 / 56
HSPF - Heating Seasonal Performance Factor	28,810		re $(H/M/L) \pm 1 dB(A)^3$ 48 / 45 / 44
Cooling Nominal Test Conditions: Heating Nominal Test Condit Indoor: 80°F DB / 67°F WB Indoor: 70°F DB / 60°F WB	ions:	ODU Net / Shippir	
Outdoor: 95°F DB / 75°F WB Outdoor: 47°F DB / 43°F WB		IDU Net / Shipping	g Weight (lbs.) 158.7 / 176.4
Electrical:	200 220 / 60 / 4	Fan:	
Power Supply¹ (V/Hz/Ø) MOP / MCA (A)	208-230 / 60 / 1 40 / 32	ODU / IDU Fan Ty	pe Propeller / Sirocco
Cooling / Heating Rated Amps (A)	14.9 / 16.4	Fan Speeds (Fan/Cool/Heat) 3 / 3 / 3	
Compressor(A)	22.0	Fan Quantity (ODU + IDU) 2 + 1	
Fan Motor (IDU + ODU) (A)	1.3 + (1.6 x 2)	Motor/Drive Brushless Digitally Controlled / Direct	
Cooling Power Input (Min~Rated~Max, kW) 1.	19 ~ 3.36 ~ 5.32	Maximum ODU Air Volume (CFM) 4,238	
Heating Power Input (Min~Rated~Max, kW)	1.34 ~ 3.69 ~ 5.8	IDU Air Volume (H/M/L) (CFM) 1,260 / 1,100 / 1,000	
Locked Rotor Amps (A)	33	Dehumidification Rate (pts/hr) ¹⁰ 6.76	
MOP - Maximum Overcurrent Protection MCA - Minimum Circuit Amp	pacity		c Pressure Operating
Piping:	0.70.51	Range (Min~Defa	ult $^{\sim}$ Max) (in-wg) 11 0.1 $^{\sim}$ 0.3 $^{\sim}$ 1.0
Installed Liquid Pipe (in., O.D.)	3/8 Flare 5/8 Flare	Notes:	
Installed Vapor Pipe (in., O.D.) IDU Liquid Connection (in., O.D.)	3/8 Flare	Acceptable operating	voltage: 187V-253V.
IDU Vapor Connection (in., O.D.) 5/8 Flare		3. Sound Pressure levels	are tested in an anechoic chamber under ISO Standard 3745.
Additional Refrigerant (oz./ft.)	0.43	conductor, stranded, shi	elded or unshielded wire and must comply with applicable local and d, the wire must be grounded to the chassis at the outdoor unit only.
Min/Max. Pipe Length (ft.)	16.4 / 246	 Power wiring cable sizes. The indoor unit come 	are tested in an anechoic chamber under ISO Standard 3745. tion cable to be minimum 14 American wire gage (AWG), 4- elded or unshielded wire and must comply with applicable local and d, the wire must be grounded to the chassis at the outdoor unit only. the must comply with the applicable local and national code. s with a dry helium charge. above sea level, with 25 ft. of refrigerant line and a 0 ft. level
Piping Length (no add'I refrig., ft.)		unierence between out	ion and muon units.
Max. Elevation (ft.)	98.4	Must follow installation instructions in the applicable LG installation manual.If the optional low ambient wind baffle (ZLABGP04A) is used, one wind baffle is required for each ODU fan.	
Features:		10. Dehumidification rat	e is based on high speed airflow.
	rain Pan Heater Quiet Function	(External Static Pressure	e is based on high speed airflow. U units have ECM fan that automatically adjusts throughout the ESP) range. Therefore, there is no default ESP value for these units. are supplied with socket adapters for pipe transitions.
 Auto restart Sleep Mode IDU co 	mpatible with 18k, 24k, 36k	13. Electric heater acce	ssory available in 3kW, 5kW, 8kW, 10kW, 15kW, and 20kW
• W2 terminal connection • Built in dry contact models)	10K, 24K, 30K	capacities. Refer to the 14. Controller not include	engineering manual for details.
Required Accessories (sold separately): Controller (Any LG wired remote controller)		The controller flot mold.	
Optional Accessories:			
☐ MultiSITE™ CRC1 - PREMTBVC0 ☐ Aux Heater Relay Ki☐ MultiSITE CRC1+ - PREMTBVC1 ☐ Dry Contact - PDRYC			
MultiSITE Comm. Mgr PBACNBTROA Low Ambient Wind	Baffle (cooling		
☐ AC Smart 5 - PACS5Ā000 ☐ operation to -4°F) - ☐ ACP 5 - PACP5A000 ☐ Electric Heater 3kW			
Simple Controller - PREMTCOOU Downflow Conversion		LCDE	ALE CERTIFIED







Wi-Fi module - PWFMDD200 Remote Temperature Sensor - ZRTBS01 for

Job Name/Location:

LVN420HV Single Zone LGRED° Vertical Air Handler Unit




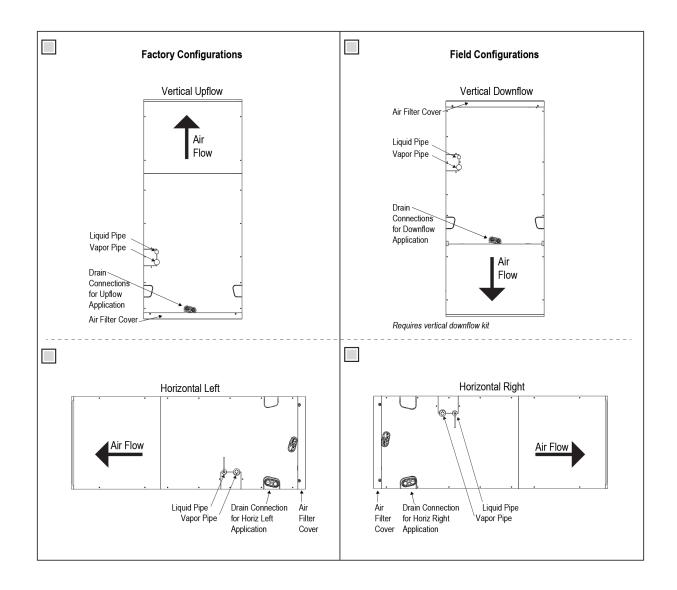



LUU420HHV Single Zone LGRED° Vertical Air Handler Unit




Tag No.:	
Date:	







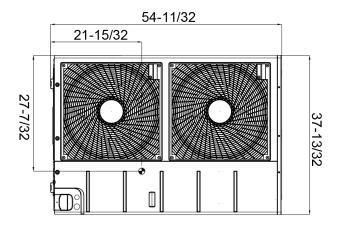









Unit: inch

Job Name/Location:

LVN420HV Single Zone LGRED° Vertical Air Handler Unit



Tag No.: Date: Life's Good PO No.:

