

Precedent Packaged Rooftop

| Application | Unit Size | Supp | ly Fan | External Dimensions (in.) | | | Operating Weight | Elevation |
|--------------------------|-----------|-----------|--------------------------|---------------------------|---------|---------|------------------|-----------|
| DX Cooling / Gas Heat | 7.5 Ton | Airflow | Total Static Pressure | Height | Width | Length | 1063.0 lb | 0.00 ft |
| | | 3000. cfm | 0.750 in H2O | 4.24 ft | 4.44 ft | 7.34 ft | | |

| Unit Features | |
|-----------------|---------------------|
| Unit Efficiency | Standard Efficiency |
| Refrigerant | R-454B Refrigerant |
| EER @ AHRI | 11.00 Number |
| IEER @ AHRI | 14.60 Number |

| Unit Electrical | | | | | |
|---------------------|----------|--|--|--|--|
| Voltage/phase/hertz | 460/60/3 | | | | |
| MCA | 22.00 A | | | | |
| MOP | 25.00 A | | | | |
| Condenser Fan FLA | 1.50 A | | | | |
| Evaporator Fan FLA | 4.60 A | | | | |
| Compressor 1 RLA | 8.10 A | | | | |
| Compressor 2 RLA | 5.20 A | | | | |
| Compressor Power | 5.95 kW | | | | |
| System Power | 8.69 kW | | | | |



Controls

Unit Controls Symbio 700

| Cooling Section | | | | |
|--|----------|-----------------------|-----------|--|
| Entering Dry Bulb 80.00 F | | Capacity | | |
| Entering Wet Bulb 67.00 F | | Gross Total | 93.62 MBh | |
| Ambient Temp 95.00 F | | Gross Latent | 20.62 MBh | |
| Leaving Coil Dry Bulb 57.25 F | | Gross Sensible | 73.00 MBh | |
| Leaving Coil Wet Bulb 56.78 F | | Net Total | 90.36 MBh | |
| Leaving Unit Dry Bulb 58.84 F | | Net Sensible | 69.74 MBh | |
| Leaving Unit Wet Bulb 57.41 F | Net Sens | sible Heat Ratio | 77.18 % | |
| Saturated Discharge Temperature 117.91 F | | Fan Motor Heat | 1.76 MBh | |
| Saturated Suction Temperature 54.50 F | Refrig (| Charge-Circuit 1 | 7.6 lb | |

| Heating Section | |
|-------------------------|---------------|
| Heating | High Gas Heat |
| Input Heating Capacity | 200.00 MBh |
| Output Heating Capacity | 162.00 MBh |
| Heating EAT | 60.00 F |
| Heating LAT | 109.51 F |
| Heating Temp Rise | 49.51 F |
| Heating Stages | 2 |

| Fan Section | |
|---------------------------------------|--|
| Indoor Fan Data | Indoor Fan Performance |
| Airflow Application Horizontal | Airflow 3000. cfm |
| Design ESP 0.750 in H2O | Supply Motor Horsepower 3.000 hp |
| Component SP 0.000 in H2O | Total Supply Motor Operating Power 0.966 hp |
| Heat SP 0.000 in H2O | |
| Total SP 0.750 in H2O | Indoor RPM 1122 rpm |
| Indoor Fan Drive Type Variable Direct | Outdoor Fan Data |
| Indoor Fan Quantity 1.00 Number | Outdoor Fan Drive Type Direct |
| Indoor Fan Type BC Plenum | Outdoor Fan Quantity 1 |
| 71. | Outdoor Fan Type Propeller |
| | Filters |
| | 1st Filter Size and Qty 2 - 18 x 24 x 2 |
| | 2nd Filter Size and Qty 3 - 24 x 16 x 2 |

2025/03/26 14:11:18 Page 1 of 8




| Acoustics | | | | | | | | |
|------------------|-------|--------|--------|--------|-------|-------|-------|-------|
| Sound Path | 63 Hz | 125 Hz | 250 Hz | 500 Hz | 1 kHz | 2 kHz | 4 kHz | 8 kHz |
| Ducted Discharge | 77 dB | 81 dB | 73 dB | 69 dB | 63 dB | 61 dB | 61 dB | 61 dB |
| Ducted Inlet | 74 dB | 74 dB | 67 dB | 56 dB | 53 dB | 51 dB | 51 dB | 51 dB |
| Outdoor Noise | 84 dB | 85 dB | 84 dB | 85 dB | 82 dB | 76 dB | 73 dB | 67 dB |


Note: Ducted Discharge/Ducted Inlet prediction data conform to AHRI 260

2025/03/26 14:11:18 Page 2 of 8



NOTES: 1. VERIFY WEIGHTS, CONNECTIONS, AND ALL DIMENSIONS WITH INSTALLER DOCUMENTS BEFORE INSTALLATION

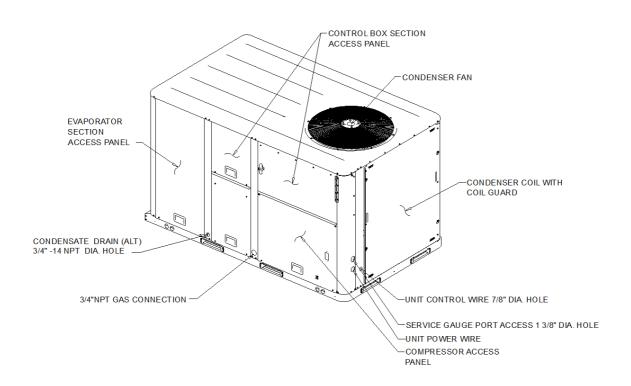


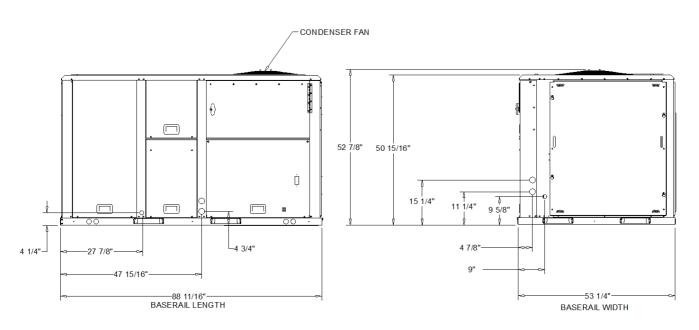


DX COOLING / GAS HEAT STANDARD EFFICIENCY

DIMENSION DRAWING

2025/03/26 14:11:18 Page 3 of 8

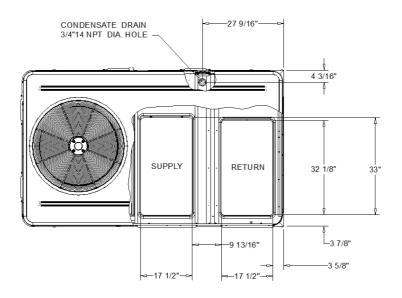

PLAN VIEW OF DOWNFLOW OPENINGS

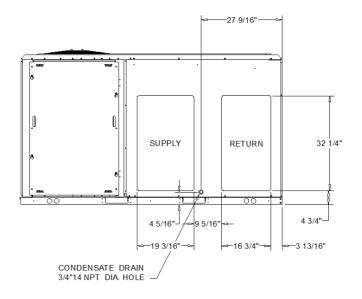

HORIZONTAL AIR FLOW OPENING

DX COOLING / GAS HEAT STANDARD EFFICIENCY

DIMENSION DRAWING


2025/03/26 14:11:18 Page 4 of 8



- NOTES: 1. APPROX. INSTALLED WEIGHT INCLUDES ALL SELECTED OPTIONS AND ACCESSORIES. 2. CORNER WEIGHTS ARE FOR BASE UNIT ONLY AND DO
- NOT INCLUDE OPTIONS OR ACCESSORIES.

 3. WEIGHT INCLUDES BOTH FACTORY AND FIELD INSTALLED
- ACCESSORY.

(C) Corner Weight: 158.0 lb (D) Corner Weight: 183.0 lb

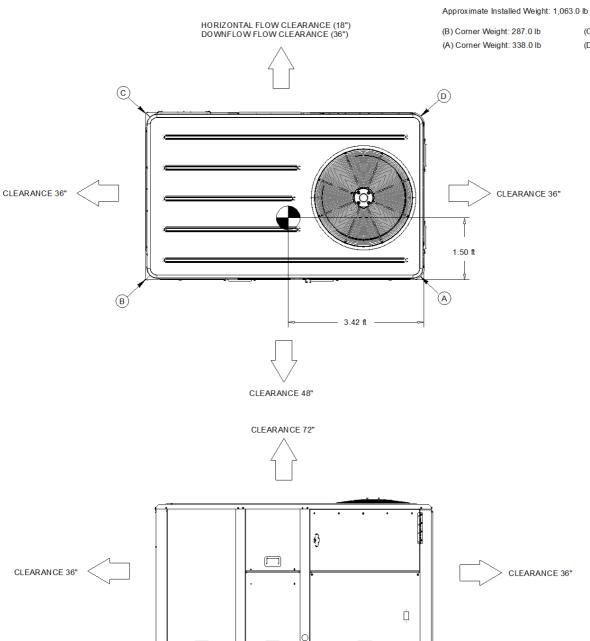


DX COOLING / GAS HEAT STANDARD EFFICIENCY

WEIGHTS AND CLEARANCES

2025/03/26 14:11:18 Page 5 of 8

NOTES:

INSTALLER DOCUMENTS REFORE INSTALLATION

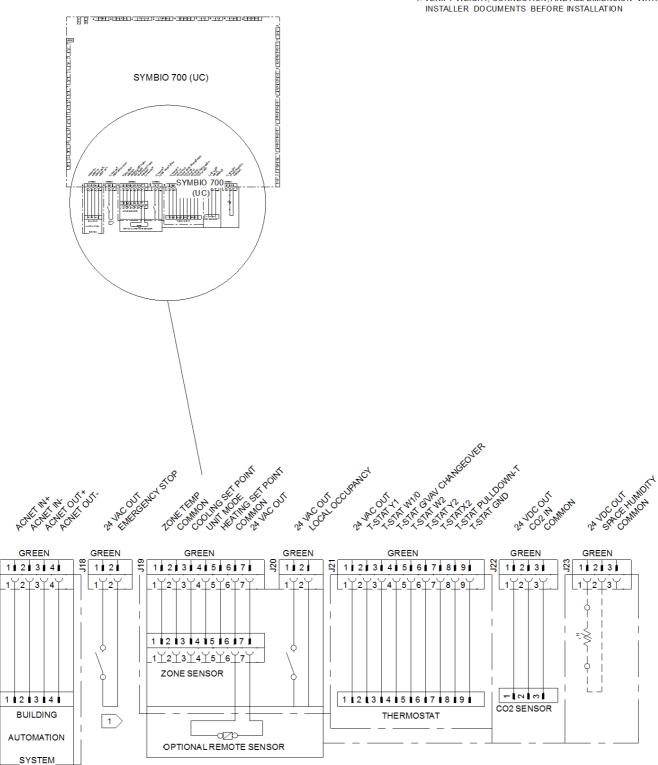

SYMBIO 700 (J17, j18, J19, J20, J21, J22, AND J23)

FIELD WIRING DRAWING

2025/03/26 14:11:18 Page 6 of 8

General

Packaged rooftop unit cooling capacities, heating capacities, and efficiencies are certified to the following standards:

- 3 to 5 ton units: AHRI Standard 210/240.
- 6 to 25 ton units: AHRI Standard 340/360.
- Gas Heating Units: ANSI Z21.47 and 10 CFR Part 431 for Commercial Warm Air.
- Convertible airflow.
- Symbio? controls operating range between 40°F and 125°F in cooling mode standard from the factory. Field-installed low ambient kit extends operating range down to 0°F.
- Factory assembled, internally wired, fully charged, and 100 percent run tested to verify cooling operation, fan and blower rotation, and control sequence.
- Colored and numbered wiring internal to the unit for simplified identification.
- cULus listed and classified in accordance for Central Cooling Air Conditioners.
- Unit shall be furnished with a leak detection system from the fact

Casing

- Zinc coated, heavy gauge, galvanized steel.
- Weather resistant pre-painted metal with galvanized substrate.
- Meets ASTM B117, 672 hour salt spray test.
- Removable single side maintenance access panels.
- Lifting handles in maintenance access panels (can be removed and reinstalled by removing fasteners while providing a water and air tight seal).
- Exposed vertical panels and top covers in the indoor air section insulated with a cleanable foil-faced, fire-retardant permanent, odorless glass fiber material.
- Base pan shall have no penetrations within the perimeter of the curb other than the raised 1 inch high downflow supply/return openings to provide an added water integrity precaution, if the condensate drain backs up.
- Base of the unit insulated with 1/8 inch, foil-faced, closed-cell insulation.
- Unit base provisions for forklift and/or crane lifting on three sides of unit.

Hail Guards

- Provides condenser coil protection.

Microchannel Coils

- Optimal heat transfer performance due to flat, streamlined tubes with small ports, and metallurgical tube-to-fin bond.
- Reduce system refrigerant charge by up to 50% leading to better compressor reliability.
- Compact all-aluminum microchannel coils reduce the unit weight.
- Recyclable all aluminum coils All aluminium construction minimizes galvanic corrosion.
- Strong aluminum brazed structure provides better fin protection.
- Flat streamlined tubes more dust resistant and easy to clean.
- Coils leak tested at the factory to ensure the pressure integrity.

Compressors

- All units have direct-drive, hermetic, scroll type compressors with centrifugal type oil pumps.
- Suction gas-cooled motor with voltage utilization range of plus or minus 10 percent of unit nameplate voltage.
- Internal overloads standard with scroll compressors.
- All units have dual compressors.
- -Three stages of cooling available on 6 to 17.5 tons units and four stages of cooling available on 20 and 25 tons units.

Filters

-Two inch standard filters shall be factory supplied on all units.

Frostat

- Utilized as a safety device.
- Opens to prevent freezing temperatures on evaporator coil.
- Temperature will need to rise to 50°F before closing.
- Utilized in low airflow or high outside air applications (cooling only).

Gas Heating Section

2025/03/26 14:11:18 Page 7 of 8

- -The heating section shall have a progressive tubular heat exchanger with corrosion-resistant aluminized steel tubes and burners as standard on all models.
- -Stainless steel heat exchanger with 409 stainless steel tubes and 439 stainless steel burners shall be optional.
- Induced draft combustion blower shall be used to pull the combustion products through the firing tubes.
- Heater shall use a direct spark ignition (DSI) system.
- On initial call for heat, the combustion blower shall purge the heat exchanger for 20 seconds before ignition.
- After three unsuccessful ignition attempts, entire heating system shall be locked out until manually reset at the thermostat/zone sensor.
- Units shall be suitable for use with natural gas or propane (field-installed kit).

Indoor Fan

- Direct drive plenum fan design 6 to 25 tons units.
- Plenum fan design backward-curved fan wheel along with an external rotor direct drive variable speed indoor motor.
- Supply fan speed adjustments can be made using the Symbio 700 or Mobile App.
- Motors are thermally protected.
- Variable speed direct drive motors are high efficiency 6 to 25 tons.

Heat Exchanger

- Compact cabinet features a tubular heat exchanger in low, medium and high heat capacities.
- Corrosion-resistant aluminized steel tubes and burners are standard on all models.
- Induced draft blower to pull the gas mixture through the burner tubes.
- Direct spark ignition and a flame sensor as a safety device to validate the flame.

2025/03/26 14:11:18 Page 8 of 8