

# Precedent Packaged Rooftop

# 

Application	Unit Size	Supp	ly Fan	External Dimensions (in.)			Operating Weight	Elevation
DX Cooling / Gas Heat	17.5 Ton	Airflow	Total Static Pressure	Height	Width	Length	2186.0 lb	0.00 ft
		7000. cfm	0.750 in H2O	4.92 ft	7.25 ft	10.25 ft		

Unit Features						
Unit Efficiency	Standard Efficiency					
Refrigerant	R-454B Refrigerant					
EER @ AHRI	10.80 Number					
IEER @ AHRI	14.00 Number					

Unit Electrical						
Voltage/phase/hertz	460/60/3					
MCA	47.00 A					
MOP	60.00 A					
Condenser Fan FLA	2.50 A					
Evaporator Fan FLA	4.60 A					
Compressor 1 RLA	17.80 A					
Compressor 2 RLA	10.50 A					
Compressor Power	15.04 kW					
System Power	20.12 kW					



# **Controls**

# Unit Controls Symbio 700

Cooling Section	
Entering Dry Bulb 80.00 F	Capacity
Entering Wet Bulb 67.00 F	Gross Total 216.32 MBh
Ambient Temp 95.00 F	Gross Latent 49.95 MBh
Leaving Coil Dry Bulb 58.00 F	Gross Sensible 166.37 MBh
Leaving Coil Wet Bulb 56.99 F	Net Total 209.41 MBh
Leaving Unit Dry Bulb 59.44 F	Net Sensible 159.46 MBh
Leaving Unit Wet Bulb 57.57 F	Net Sensible Heat Ratio 76.15 %
Saturated Discharge Temperature 122.50 F	Fan Motor Heat 2.72 MBh
Saturated Suction Temperature 52 00 F	Refrig Charge-Circuit 1 12 0 lb

Heating Section	
Heating	High Gas Heat
Input Heating Capacity	400.00 MBh
Output Heating Capacity	324.00 MBh
Heating EAT	
Heating LAT	102.47 F
Heating Temp Rise	42.47 F

Fan Section					
Indoor F	an Data	Indoor Fan Performance			
Airflow Application	Downflow	Airflow	7000. cfm		
Design ESP	0.750 in H2O	Supply Motor Horsepower	3.000 hp		
Component SP	0.000 in H2O	Total Supply Motor Operating Power	2 001 hp		
Heat SP	0.000 in H2O				
Total SP	0.750 in H2O	Indoor RPM	•		
Indoor Fan Drive Type	Variable Direct	Outdoor			
Indoor Fan Quantity	2.00 Number	Outdoor Fan Drive Type			
Indoor Fan Type	BC Plenum	Outdoor Fan Quantity			
		Outdoor Fan Type	Propeller		
		Filt	ers		
		1st Filter Size and Qty	8 - 20 x 24 x 2		

2025/03/26 14:26:59



Acoustics								
Sound Path	63 Hz	125 Hz	250 Hz	500 Hz	1 kHz	2 kHz	4 kHz	8 kHz
Ducted Discharge	80. dB	90. dB	77 dB	71 dB	65 dB	62 dB	61 dB	60. dB
Ducted Inlet	76 dB	84 dB	70. dB	64 dB	59 dB	56 dB	56 dB	54 dB
Outdoor Noise	88 dB	88 dB	91 dB	89 dB	86 dB	82 dB	79 dB	73 dB

Note: Ducted Discharge/Ducted Inlet prediction data conform to AHRI 260

2025/03/26 14:26:59 Page 2 of 8





#### NOTES:

- NOTES.

  1. THRU -THE -BASE ELECTRICAL IS NOT STANDARD ON ALL UNITS.

  2. VERIFY WEIGHTS, CONNECTIONS, AND ALL DIMENSIONS WITH INSTALLER DOCUMENTS BEFORE INSTALLATION

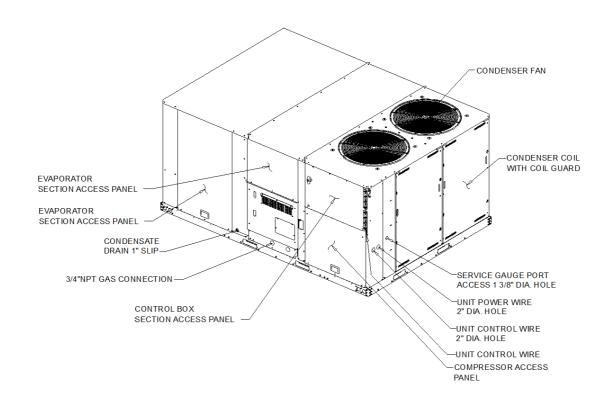


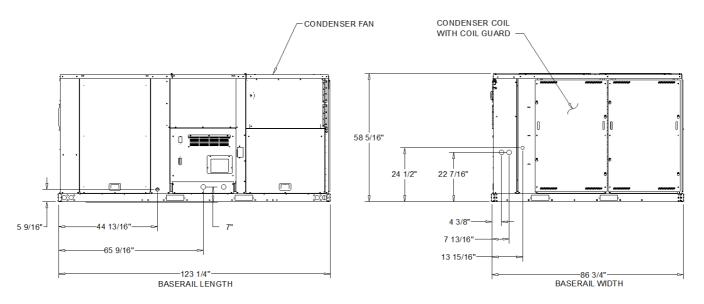


### DX COOLING / GAS HEAT STANDARD EFFICIENCY

DIMENSION DRAWING

2025/03/26 14:26:59 Page 3 of 8

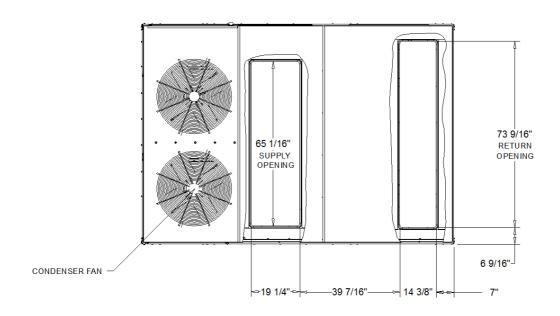

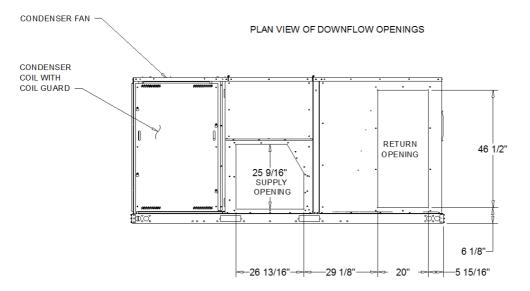

HORIZONTAL AIR FLOW OPENING

DX COOLING / GAS HEAT STANDARD EFFICIENCY

DIMENSION DRAWING

2025/03/26 14:26:59 Page 4 of 8




- NOTES:

  1. APPROX. INSTALLED WEIGHT INCLUDES ALL SELECTED OPTIONS AND ACCESSORIES.

  2. CORNER WEIGHTS ARE FOR BASE UNIT ONLY AND DO NOT INCLUDE OPTIONS OR ACCESSORIES.

  3. WEIGHT INCLUDES BOTH FACTORY AND FIELD INSTALLED ACCESSORY.
- ACCESSORY.

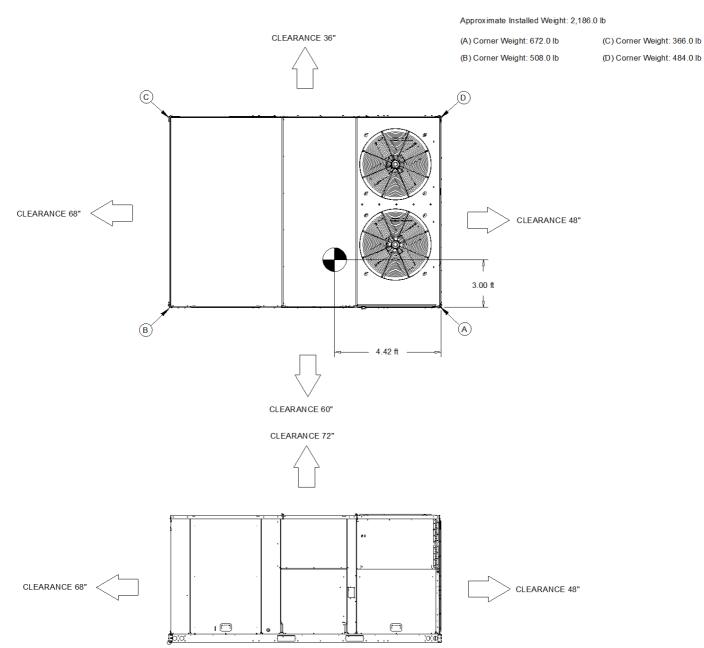

# DX COOLING / GAS HEAT STANDARD EFFICIENCY


WEIGHTS AND CLEARANCES

2025/03/26 14:26:59 Page 5 of 8



#### NOTES:

INSTALLER DOCUMENTS REFORE INSTALLATION

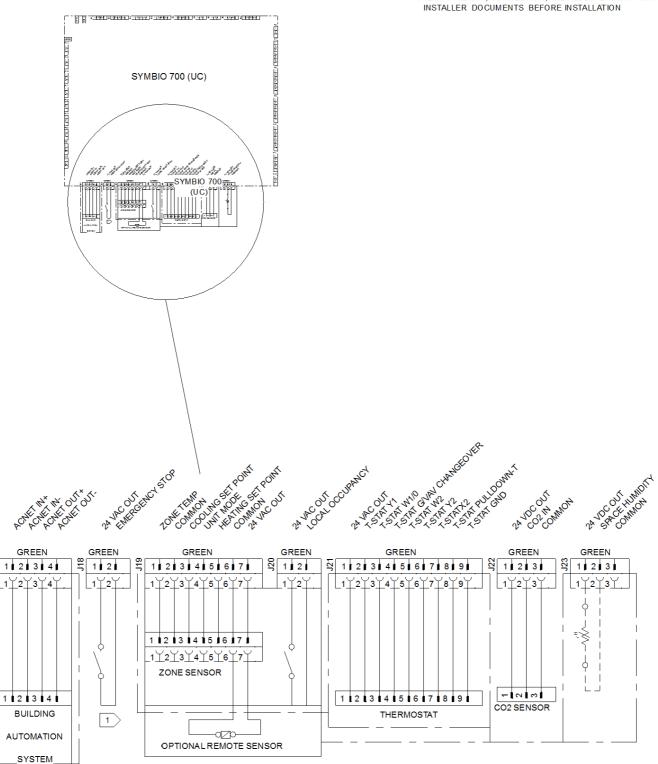

SYMBIO 700 (J17, j18, J19, J20, J21, J22, AND J23)

FIELD WIRING DRAWING

2025/03/26 14:26:59 Page 6 of 8

#### General

Packaged rooftop unit cooling capacities, heating capacities, and efficiencies are certified to the following standards:

- 3 to 5 ton units: AHRI Standard 210/240.
- 6 to 25 ton units: AHRI Standard 340/360.
- Gas Heating Units: ANSI Z21.47 and 10 CFR Part 431 for Commercial Warm Air.
- Convertible airflow.
- Symbio? controls operating range between 40°F and 125°F in cooling mode standard from the factory. Field-installed low ambient kit extends operating range down to 0°F.
- Factory assembled, internally wired, fully charged, and 100 percent run tested to verify cooling operation, fan and blower rotation, and control sequence.
- Colored and numbered wiring internal to the unit for simplified identification.
- cULus listed and classified in accordance for Central Cooling Air Conditioners.
- Unit shall be furnished with a leak detection system from the fact

# Casing

- Zinc coated, heavy gauge, galvanized steel.
- Weather resistant pre-painted metal with galvanized substrate.
- Meets ASTM B117, 672 hour salt spray test.
- Removable single side maintenance access panels.
- Lifting handles in maintenance access panels (can be removed and reinstalled by removing fasteners while providing a water and air tight seal).
- Exposed vertical panels and top covers in the indoor air section insulated with a cleanable foil-faced, fire-retardant permanent, odorless glass fiber material.
- Base pan shall have no penetrations within the perimeter of the curb other than the raised 1 inch high downflow supply/return openings to provide an added water integrity precaution, if the condensate drain backs up.
- Base of the unit insulated with 1/8 inch, foil-faced, closed-cell insulation.
- Unit base provisions for forklift and/or crane lifting on three sides of unit.

#### **Hail Guards**

- Provides condenser coil protection.

#### Microchannel Coils

- Optimal heat transfer performance due to flat, streamlined tubes with small ports, and metallurgical tube-to-fin bond.
- Reduce system refrigerant charge by up to 50% leading to better compressor reliability.
- Compact all-aluminum microchannel coils reduce the unit weight.
- Recyclable all aluminum coils All aluminium construction minimizes galvanic corrosion.
- Strong aluminum brazed structure provides better fin protection.
- Flat streamlined tubes more dust resistant and easy to clean.
- Coils leak tested at the factory to ensure the pressure integrity.

#### Compressors

- All units have direct-drive, hermetic, scroll type compressors with centrifugal type oil pumps.
- Suction gas-cooled motor with voltage utilization range of plus or minus 10 percent of unit nameplate voltage.
- Internal overloads standard with scroll compressors.
- All units have dual compressors.
- -Three stages of cooling available on 6 to 17.5 tons units and four stages of cooling available on 20 and 25 tons units.

# **Filters**

-Two inch standard filters shall be factory supplied on all units.

## **Frostat**

- Utilized as a safety device.
- Opens to prevent freezing temperatures on evaporator coil.
- Temperature will need to rise to 50°F before closing.
- Utilized in low airflow or high outside air applications (cooling only).

# **Gas Heating Section**

2025/03/26 14:26:59 Page 7 of 8

- -The heating section shall have a progressive tubular heat exchanger with corrosion-resistant aluminized steel tubes and burners as standard on all models.
- -Stainless steel heat exchanger with 409 stainless steel tubes and 439 stainless steel burners shall be optional.
- Induced draft combustion blower shall be used to pull the combustion products through the firing tubes.
- Heater shall use a direct spark ignition (DSI) system.
- On initial call for heat, the combustion blower shall purge the heat exchanger for 20 seconds before ignition.
- After three unsuccessful ignition attempts, entire heating system shall be locked out until manually reset at the thermostat/zone sensor.
- Units shall be suitable for use with natural gas or propane (field-installed kit).

### **Indoor Fan**

- Direct drive plenum fan design 6 to 25 tons units.
- Plenum fan design backward-curved fan wheel along with an external rotor direct drive variable speed indoor motor.
- Supply fan speed adjustments can be made using the Symbio 700 or Mobile App.
- Motors are thermally protected.
- Variable speed direct drive motors are high efficiency 6 to 25 tons.

# **Heat Exchanger**

- Compact cabinet features a tubular heat exchanger in low, medium and high heat capacities.
- Corrosion-resistant aluminized steel tubes and burners are standard on all models.
- Induced draft blower to pull the gas mixture through the burner tubes.
- Direct spark ignition and a flame sensor as a safety device to validate the flame.

2025/03/26 14:26:59 Page 8 of 8