

Job Name/Location:

Tag #:

Date:

For:	File	Resubmit
	Approval	Other _____

PO No.:

Architect:

GC:

Engr:

Mech:

Rep:
(Company)

(Project Manager)

PQSH1200

Outdoor Unit Drain Pan Heater



Electrical:


Power Requirements	Wiring Harness Plugs into Outdoor Unit Control Board Terminal
Control Requirements	Wiring Harness Plugs into Outdoor Unit Control Board Terminal
Capacity (W)	120W

Compatibility:

Multi F Outdoor Units manufactured May 2015 and after; Multi F MAX Outdoor Units manufactured May 2015 and after; Single Zone Vertical Air Handler Outdoor Units, 18,000+ Btu/h Single Zone Cassette and High Static Duct Outdoor Units manufactured April 2017 and after; 24,000 and 60,000 Btu/h Multi V S Outdoor Units, 38,000 to 53,000 Btu/h Multi V S Outdoor Units manufactured after May 2018.

Notes:

1. Follow all installation instructions in the Base Pan Heater Installation manual.
2. Ensure that there is at least 1-3/16" clearance from the outdoor unit fan.
3. As a safety precaution, the heater will not energize if the outdoor temperature is higher than 32°F.
4. To determine the date of the outdoor unit manufacture, refer to the first three digits of the serial number. First digit represents the year; second and third digits represent the month. For example, SN 503XXXXXX indicates date of manufacture of March 2015.
5. Appearances may vary depending on model.

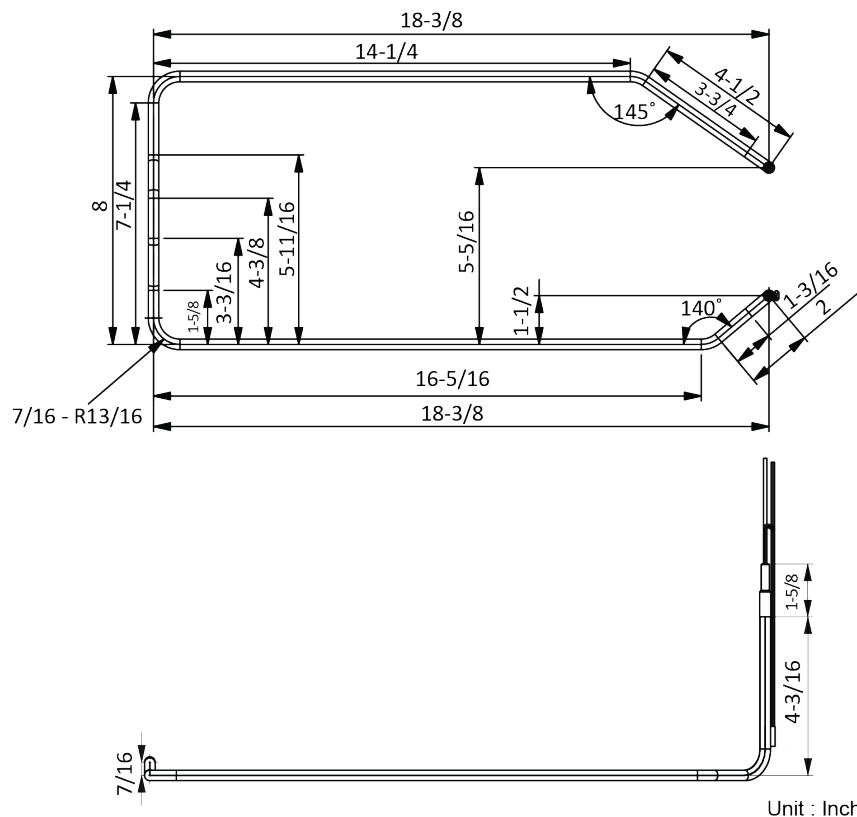

Unit : Inch